

BRANZ **Type Test**

FH 5933-TT [2016]

CONE CALORIMETER TEST AND NZBC VERIFICATION METHOD C/VM2 APPENDIX A AND NCC SPECIFICATION C1.10 PERFORMANCE OF AEROFLEX/AEROCEL

CLIENT

Aeroflex Co Ltd
111/7 111/11 Mu 2 Tambol Makhamku Amphur
Nikom pattana Rayong, 21180
Thailand



All tests and procedures reported herein, unless indicated, have been performed in accordance with the laboratory's scope of accreditation.

PROJECT NUMBER:

FT5933

ISSUE DATE:

1 June 2016

EXPIRY DATE:

1 June 2021

PAGE:

1 of 14

TEST SUMMARY

Objective

To conduct cone calorimeter testing and reduce the data in accordance with ISO 5660 and AS/NZS 3837 on client supplied specimens for the purposes of determination of the Group Classifications in accordance with;

- New Zealand Building Code (NZBC) Verification Method C/VM2 Appendix A
- National Construction Code (NCC) Volume One Specifications C1.10 and A 2.4 of the Building Code of Australia (BCA).

Test sponsor

Aeroflex Co Ltd
111/7 111/11 Mu 2 Tambol Makhamku Amphur
Nikom pattana Rayong, 21180
Thailand

Description of test specimen

The product submitted by the client for testing was identified by the client as Aeroflex/Aerocel, a closed cell, elastomeric, thermal insulation made of synthetic rubber.

Date of tests

6 and 12 May 2016.

Test results

For the purposes of compliance with the relevant building code documents, the following classification is considered applicable to the tested sample as described in Section 1.

Building Code Document	Group Number Classification
NZBC Verification Method C/VM2 Appendix A	1
NCC Specifications C1.10 and A 2.4	1 The average specific extinction area was greater than the 250 m ² /kg limit.

LIMITATION

The results reported here relate only to the item/s tested.

TERMS AND CONDITIONS

This report is issued in accordance with the Terms and Conditions as detailed and agreed in the BRANZ Services Agreement for this work.



TO WHOM IT MAY CONCERN

Both NATA (National Association of Testing Authorities, Australia) and IANZ (International Accreditation New Zealand) are signatories to the ILAC Mutual Recognition Arrangement. Under the terms of this arrangement, each signatory:

- (i) recognises within its scope of recognition of this Arrangement the accreditation of an organisation by other signatories as being equivalent to an accreditation by its own organisation,
- (ii) accepts, for its own purposes, endorsed* certificates or reports issued by organisations accredited by other signatories on the same basis as it accepts endorsed* certificates or reports issued by its own accredited organisations,
- (iii) recommends and promotes the acceptance by users in its economy of endorsed* certificates and reports,

* The word "endorsed" means a certificate or report bearing an Arrangement signatory's accreditation symbol (or mark) preferably combined with the ILAC-MRA Mark.

Signed:


 Jennifer Evans
 NATA CEO


 Dr Llewellyn Richards
 IANZ CEO

Date: 24 March 2014

Date: 24th March 2014



REPORT NUMBER:

FH 5933-TT

ISSUE DATE:

1 June 2016

EXPIRY DATE:

1 June 2021

PAGE:

3 of 14

LFH



PCRC



CONTENTS

SIGNATORIES	5
DOCUMENT REVISION STATUS	5
1. GENERAL	6
1.1 Sample measurements	6
2. EXPERIMENTAL PROCEDURE	7
2.1 Test standard	7
2.2 Test date	7
2.3 Specimen conditioning	7
2.4 Specimen wrapping and preparation.....	7
2.5 Test programme.....	7
2.6 Specimen Selection	7
3. TEST RESULTS AND REDUCED DATA	8
3.1 Test results and reduced data – NZBC C/VM2	8
3.2 Test results and reduced data – NCC C1.10	9
4. SUMMARY	10
5. CLASSIFICATION IN ACCORDANCE WITH NZBC VERIFICATION METHOD C/VM2 APPENDIX A	12
6. CLASSIFICATION IN ACCORDANCE WITH NCC VOLUME ONE SPECIFICATION C1.10	12
7. NZBC CONCLUSION	13
8. NCC CONCLUSION	13

FIGURES

Figure 1: Representative specimen (front face on left, back face on right)	6
Figure 2: Rate of heat release versus time.....	11

TABLES

Table 1: Physical parameters.....	6
Table 2: Test results and reduced data – NZBC C/VM2.....	8
Table 3: Test results and reduced data – NCC C1.10	9
Table 4: Heat release rate.....	10
Table 5: Report summary.....	10
Table 6: NZBC Group classification and smoke extinction area	12
Table 7: NCC Group classification and smoke extinction area	12



REPORT NUMBER:
FH 5933-TT

ISSUE DATE:
1 June 2016

EXPIRY DATE:
1 June 2021

PAGE:
4 of 14



SIGNATORIES



Author

Lukas Hersche
Fire Technician



Reviewer

P. C. R. Collier
Senior Fire Testing Engineer
IANZ Approved Signatory

DOCUMENT REVISION STATUS

ISSUE NO.	DATE ISSUED	EXPIRY DATE	DESCRIPTION
1	1 June 2016	1 June 2021	Initial Issue



PROJECT NUMBER:

FH 5933-TT

ISSUE DATE:

1 June 2016

EXPIRY DATE:

1 June 2021

PAGE:

5 of 14


THE LEGAL VALIDITY OF THIS REPORT CAN ONLY BE CLAIMED ON PRESENTATION OF THE COMPLETE SIGNED PAPER REPORT. EXTRACTS OR ABRIDGMENTS OF THIS REPORT SHALL NOT BE PUBLISHED WITHOUT PERMISSION FROM BRANZ LTD.

1. GENERAL

The product submitted by the client for testing was identified by the client as Aeroflex/Aerocel, a closed cell, elastomeric, thermal insulation made of synthetic rubber.

Figure 1 illustrates a representative specimen of that tested.

Figure 1: Representative specimen (front face on left, back face on right)

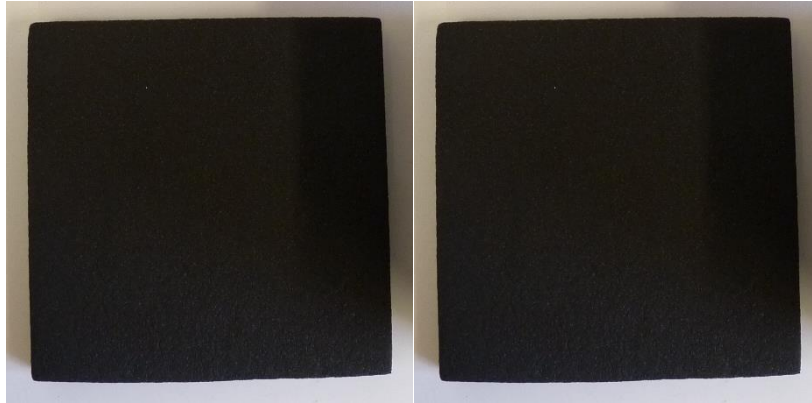

1.1 Sample measurements

The following physical parameters were measured for each specimen prior to testing.

Table 1: Physical parameters

Specimen ID	Initial properties		Overall apparent density (kg/m ³)
	Mass (g)	Mean thickness (mm)	
FH5933-2-50-1	7.6	13.3	57
FH5933-2-50-2	7.6	13.0	58
FH5933-2-50-3	7.6	13.0	58



REPORT NUMBER:
FH 5933-TT

ISSUE DATE:
1 June 2016

EXPIRY DATE:
1 June 2021

PAGE:
6 of 14



2. EXPERIMENTAL PROCEDURE

2.1 Test standard

The tests were carried out and data reduced according to the test procedures described in ISO 5660: (2002), Reaction-to-fire tests – Heat release, smoke production and mass loss – Part 1: Heat release rate, and Part 2: Smoke production rate, and AS/NZS 3837:1998 ‘Method of test for heat and smoke release rates for materials and products using an oxygen consumption calorimeter’; (the test standard). The sample preparation and test procedure were as described in 2.4 and 2.5.

2.2 Test date

The tests were conducted on 6 and 12 May 2016 by Mr Lukas Hersche at BRANZ Limited laboratories, Judgeford, New Zealand.

2.3 Specimen conditioning

All specimens were conditioned to moisture equilibrium (constant weight), at a temperature of $23 \pm 2^{\circ}\text{C}$ and a relative humidity of $50 \pm 5\%$ immediately prior to testing.

2.4 Specimen wrapping and preparation

All tests were conducted and the specimens prepared in accordance with the test standard. The spark igniter and the stainless steel retainer frame were used. All specimens were wrapped in a single layer of aluminium foil, covering the unexposed surfaces.

2.5 Test programme

The test program consisted of three replicate specimens as identified in the above table, tested at an irradiance level of 50 kW/m^2 . All tests were carried out with the specimen horizontal, and with a nominal duct flow rate of $0.024 \text{ m}^3/\text{s}$.

2.6 Specimen Selection

BRANZ was not involved in the selection of the materials submitted for testing. The test materials used were supplied to the laboratory by the client.



REPORT NUMBER:

FH 5933-TT

ISSUE DATE:

1 June 2016

EXPIRY DATE

1 June 2021

PAGE:

7 of 14

LFH

PCRC

3. TEST RESULTS AND REDUCED DATA

3.1 Test results and reduced data – NZBC C/VM2

Table 2: Test results and reduced data – NZBC C/VM2

Material	Test specimens as described in Section 1 (in accordance with ISO 5660)			Mean
Specimen test number	FH5933-2-50-1	FH5933-2-50-2	FH5933-2-50-3	
Test Date	6/05/2016	12/05/2016	12/05/2016	
Time to sustained flaming	s	-	-	0
Observations ^a		-	-	
Test duration ^b	s	1800**	914*	1505
Mass remaining, m_f	g	0.1	1.0	0.5
Mass pyrolyzed	%	98.2%	87.1%	93.6%
Specimen mass loss ^c	kg/m ²	0.8	0.7	0.8
Specimen mass loss rate ^c	g/m ² .s	0.5	0.8	0.6
Heat release rate				
peak, \dot{q}_{max}''	kW/m ²	41.9	38.1	39.8
average, \dot{q}_{avg}''				
Over 60 s from ignition	kW/m ²	20.6	18.9	19.8
Over 180 s from ignition	kW/m ²	17.4	14.3	15.7
Over 300 s from ignition	kW/m ²	16.5	14.2	15.2
Total heat released	MJ/m ²	11.2	4.4	14.3
Average Specific Extinction Area	m ² /kg	388.6	431.7	387.0
Effective heat of combustion ^d , $\Delta h_{c,eff}$	MJ/kg	13.3	5.9	12.2

Notes :

^a no significant observations were recorded

^b determined by * X_{O_2} returning to the pre-test value within 100 ppm of oxygen concentration for 10 minutes

** 30 minutes after time to sustained flaming or without ignition

^c from ignition to end of test;

^d from the start of the test

+ value calculated using data beyond the official end of test time according to the test standard.

NR not recorded



REPORT NUMBER:
FH 5933-TT

ISSUE DATE:
1 June 2016

EXPIRY DATE:
1 June 2021

PAGE:
8 of 14



3.2 Test results and reduced data – NCC C1.10

Table 3: Test results and reduced data – NCC C1.10

Material	Test specimens as described in Section 1 (in accordance with AS/NZS 3837)			Mean
Specimen test number	FH5933-2-50-1	FH5933-2-50-2	FH5933-2-50-3	
Test Date	6/05/2016	12/05/2016	12/05/2016	
Time to sustained flaming	s	0	0	0
Observations ^a	-	-	-	
Test duration ^b	s	600***	600***	600
Mass remaining, m_f	g	2.0	1.6	1.8
Mass pyrolyzed	%	73.4%	79.4%	76.0%
Specimen mass loss ^c	kg/m ²	0.6	0.7	0.7
Specimen mass loss rate ^c	g/m ² .s	6.9	5.8	6.7
Heat release rate				
peak, \dot{q}_{max}''	kW/m ²	41.9	38.1	39.8
average, \dot{q}_{avg}''				
Over 60 s from ignition	kW/m ²	20.6	18.9	19.8
Over 180 s from ignition	kW/m ²	17.4	14.3	15.7
Over 300 s from ignition	kW/m ²	16.5	14.2	15.2
Total heat released	MJ/m ²	5.6	4.4	5.0
Average Specific Extinction Area	m ² /kg	457.8	474.3	448.5
Effective heat of combustion ^d , $\Delta h_{c,eff}$	MJ/kg	8.8	6.5	7.8

Notes :

^a no significant observations were recorded

^b determined by

* average mass loss over 1 minute dropped below 150 g/m²

** two minutes after flameout or other signs of combustion cease

*** 60 minutes have elapsed or 10 minutes without ignition

^c from ignition to end of test;

^d from the start of the test

+ value calculated using data beyond the official end of test time according to the test standard.

NR not recorded



REPORT NUMBER:
FH 5933-TT

ISSUE DATE:
1 June 2016

EXPIRY DATE
1 June 2021

PAGE:
9 of 14



4. SUMMARY

The test standards require that the mean heat release rate (HRR) readings over the first 180 s from ignition for the three specimens should differ by no more than 10% of the arithmetic mean of the three readings. In the event of this criterion not being met, a further three specimens are required to be tested.

Table 4: Heat release rate

Specimen ID	Average HRR over 180 s from ignition	Arithmetic mean	% difference from the arithmetic mean
FH5933-2-50-1	17.4	15.7	11.0%
FH5933-2-50-2	14.3		-9.0%
FH5933-2-50-3	15.4		-2.0%

Table 4 identifies that one specimen exposed to 50 kW/m² irradiance did not meet the acceptance criteria. A further set of three tests as required by the test standard was deemed not necessary and were not tested.

The report summary for the specimens as described in Section 1, exposed to an irradiance of 50 kW/m² is given in table below with rates of heat release illustrated in Figure 2.

Table 5: Report summary

Mean Specimen thickness (mm)	Irradiance (kW/m ²)	Mean Time to Ignition (s)	Mean Peak Heat Release Rate (kW/m ²)	Average Specific Extinction Area (m ² /kg)
13.1	50	0	39.8	387.0 (NZBC) 448.5 (NCC)



REPORT NUMBER:
FH 5933-TT


ISSUE DATE:
1 June 2016

EXPIRY DATE:
1 June 2021

PAGE:
10 of 14



Figure 2: Rate of heat release versus time

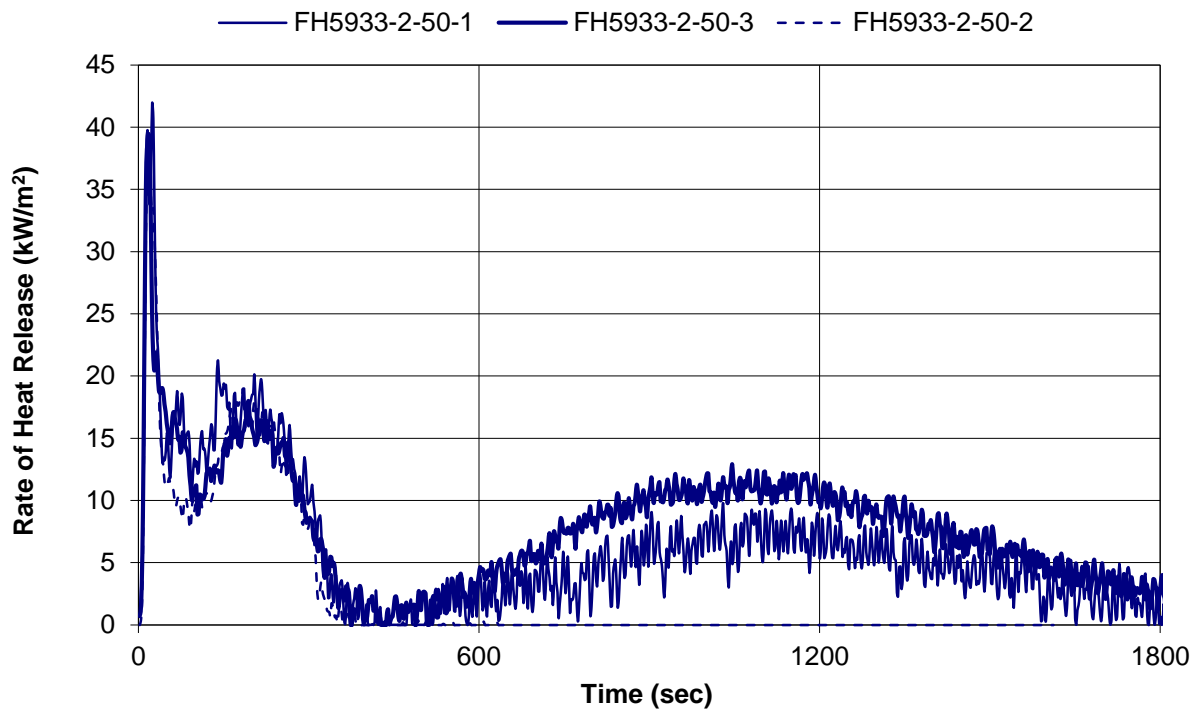

REPORT NUMBER:
FH 5933-TT

ISSUE DATE:
1 June 2016

EXPIRY DATE:
1 June 2021

PAGE:
11 of 14

LFH
[Signature]

PCRC
[Signature]

THE LEGAL VALIDITY OF THIS REPORT CAN ONLY BE CLAIMED ON PRESENTATION OF THE COMPLETE SIGNED PAPER REPORT.
EXTRACTS OR ABRIDGMENTS OF THIS REPORT SHALL NOT BE PUBLISHED WITHOUT PERMISSION FROM BRANZ LTD.

5. CLASSIFICATION IN ACCORDANCE WITH NZBC VERIFICATION METHOD C/VM2 APPENDIX A

The following classification has been assessed in accordance with the New Zealand Building Code Verification Method C/VM2 Appendix A: Establishing Group Numbers for lining materials. Calculations were carried out according to section A1.3 for predicting a material's group number for each specimen tested. It states that "If a different classification group is obtained for different specimens tested, then the highest (worst) classification for any specimen must be taken as the final classification for that material." The classification for the specimens as described in Section 1 is as follows:

Table 6: NZBC Group classification and smoke extinction area

	Sample 1	Sample 2	Sample 3	Classification
Group Number Classification	1	1	1	1
Average Specific Extinction Area (m ² /kg)	388.6	431.7	340.6	

In accordance with Verification Method C/VM2 Appendix A, samples achieving either a Group Number classification 1 or 2, and with an average specific extinction area less than 250 m²/kg are identified with "S" post-script to the Group number. The tested samples recorded an average specific extinction area of 387 m²/kg which is more than the 250 m²/kg limit.

6. CLASSIFICATION IN ACCORDANCE WITH NCC VOLUME ONE SPECIFICATION C1.10

Calculations were carried out according to Specification A2.4. The classification and for smoke extinction area for the sample as described in Section 1 is as follows:

Table 7: NCC Group classification and smoke extinction area

	Specimen 1	Specimen 2	Specimen 3	Classification
Group Number Classification	1	1	1	1
Average Specific Extinction Area (m ² /kg)	457.8	474.3	413.3	

The tested samples recorded an average specific extinction area of 448.5 m²/kg which is greater than the 250 m²/kg limit and therefore it may only be used in buildings with a sprinkler system complying with Specification E1.5 in accordance with Specification C1.10 Table 2.



REPORT NUMBER:

FH 5933-TT

ISSUE DATE:

1 June 2016

EXPIRY DATE:

1 June 2021

PAGE:

12 of 14



7. NZBC CONCLUSION

The cone calorimeter testing was carried out on the specimens as described in Section 1. For the purposes of compliance with the NZBC Verification Method C/VM2 Appendix A, the following classification is considered applicable to the material as described in Section 1.

Group Number Classification	1
------------------------------------	----------

8. NCC CONCLUSION

The cone calorimeter testing was carried out on the specimens as described in Section 1. For the purposes of compliance with the NCC Volume One Specification C1.10 for the Classification of Fire Performance of Wall and Ceiling Lining Materials, the following classification is considered applicable to the material as described in Section 1.

Group Number Classification	1
The average specific extinction area was greater than the 250 m ² /kg limit.	



REPORT NUMBER:

FH 5933-TT

ISSUE DATE:

1 June 2016

EXPIRY DATE:

1 June 2021

PAGE:

13 of 14

LFH

PCRC

BRANZ Type Test Summary

This is to certify that the specimen described below has been tested by BRANZ Ltd on behalf of

Aeroflex Co Ltd
111/7 111/11 Mu 2 Tambol Makhamku Amphur
Nikomattana Rayong, 21180
Thailand

Test standards: ISO 5660 Parts 1 and 2, AS/NZS 3837:1998

Specimen name: Aeroflex/Aerocel.

Specimen description: The product submitted by the client for testing was identified by the client as a closed cell, elastomeric, thermal insulation made of synthetic rubber.

Orientation: From the direction tested.

A full description of the test specimen and the test results are given in BRANZ Test Report:
Fire Test FH 5933-TT – Test date 6 and 12 May 2016.

Regulatory authorities are advised to examine test reports before approving any product.

The test results were the basis for the following:

Building Code Document	Group Number Classification
NZBC Verification Method C/VM2 Appendix A	1
NCC Specifications C1.10 and A 2.4	1 The average specific extinction area was greater than the 250 m ² /kg limit.

Issue Date:
1 June 2016

Expiry Date:
1 June 2021



The National Association of Testing Authorities (NATA) and International Accreditation New Zealand (IANZ) are both signatories of the ILAC Mutual Recognition Agreement. Users of tests reports are recommended to accept test reports in the name of either accreditation body.



REPORT NUMBER:
FH 5933-TT

ISSUE DATE:
1 June 2016

EXPIRY DATE:
1 June 2021

PAGE:
14 of 14

